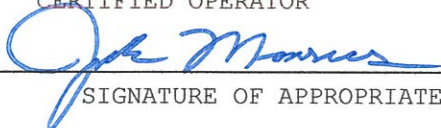


**MONTHLY OPERATION REPORT
OF
WATER TREATMENT PLANT**

For Month of May 2017

<u>Flint Water Plant</u> NAME OF WATER SYSTEM	<u>2310</u> WSSN	<u>Genesee</u> COUNTY
<u>John Monsees</u> CERTIFIED OPERATOR		<u>D-1</u> CLASSIFICATION
 SIGNATURE OF APPROPRIATE OFFICIAL		

TREATMENT RATE AND FILTER DATA

1. Treatment Rate, Maximum 14.40 Million Gallons Per Day
2. Treatment Rate, Approved Rated Plant Capacity 36 Million Gallons per Day
3. Average Filter Run N/A Hours, Average Head Loss N/A Feet
4. Average Filtration Rate N/A Gallons per Square Ft. per Minute
5. Maximum Filtration Rate N/A Gallons per Square Ft. per Minute
6. Average Wash Water Use N/A percent of Treated Water

CHEMICAL DATA

7. Sodium Hypochlorite on hand at CS2 1038 gal.: Estimated supply 12 days
8. Sodium Hypochlorite on hand at outstations 467 gal: Estimated supply 139 days
9. Phosphoric Acid on hand 1505 gal.: Estimated supply 58 days
9. Sodium Hydroxide on hand 1372 gal.: Estimated supply 16 days

Remarks:

Submit to: MDEQ - Office of Drinking Water & Municipal Assistance
LANSING DISTRICT OFFICE
525 West Allegan Street, 1st Floor South
(Constitution Hall)
PO Box 30242
Lansing, MI 48909-7742



Fluoridation & Chlorination

WSSN 2310

May-17

D A T E	Fluoride Applied F mg/l	Fluoride Analyses mg/l			Chlorine App. Mg/l			Chlorine Residual mg/l								
		Raw	Tap	Dist	Chlori ne App. Mg/l	Chlorine (prior to filtration) mg/L OCl ⁻	Post Chlorine mg/L		Sta II	Dort	3MG Well	Tap				
									Free	Free	Free	Free				
		14	15	16	17	18	19	20	21	22	23	24	25	26	27	28
1			0.63		1.15				0.9						1.8	
2			0.75		1.14				0.9						1.8	
3			0.83		1.12				0.9						1.9	
4			0.84		1.17				0.9						1.9	
5			0.80		1.15				0.8						1.8	
6			0.87		1.15				0.9						1.9	
7			0.86		1.14				0.9						1.9	
8			0.79		1.16				0.9						1.7	
9			0.82		1.22				0.9						1.8	
10			0.86		1.14				0.9						1.8	
11			0.83		1.16				0.9						1.8	
12			0.74		1.07				0.9						1.8	
13			0.76		1.11				0.9						1.9	
14			0.77		1.07				0.9						1.9	
15			0.75		1.12				0.9						1.8	
16			0.82		1.15				0.9						1.7	
17			0.80		1.11				1.0						1.8	
18			0.79		1.10				0.9						1.7	
19			0.88		1.06				0.9						1.8	
20			0.83		1.16				0.9						1.9	
21			0.77		1.13				0.9						1.8	
22			0.83		1.08				0.8						1.8	
23			0.83		1.05				0.9						1.7	
24			0.80		1.11				0.8						1.8	
25			0.84		1.09				1.0						1.9	
26			0.78		1.29				0.8						1.8	
27			0.84		1.17				0.9						1.9	
28			0.81		1.17				0.9						1.8	
29			0.72		1.18				0.9						2.0	
30			0.87		1.03				0.9						1.9	
31			0.76		1.10				0.9						1.6	
AVG			0.80		1.13				0.9						1.8	
MAX			0.88		1.29				1.0						2.0	
MIN			0.63		1.03				0.8						1.6	



Chemical Analyses WSSN 2310 May-17

D A T E	pH		Total Hardness as CaCO ₃ mg/l		Total Alkalinity as CaCO ₃ mg/l		NonCarbonate Hardness as CaCO ₃ mg/l		Iron mg/L		Calcium Ca ²⁺ mg/l		Magnesium as Mg ²⁺ mg/l		Chloride as Cl ⁻ mg/l	
	CSII	Tap	Raw	Tap	Raw	Tap	Raw	Tap	Raw	Tap	Raw	Tap	Raw	Tap	Raw	Tap
	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44
1	7.31	7.36		98		68		30		0.01		29.7		5.8		13
2	7.26	7.24		98		74		24		0.01		30.5		5.3		12
3	7.21	7.33		96		70		26		0.01		31.3		4.4		12
4	7.27	7.31		100		70		30		0.01		32.1		4.9		12
5	7.31	7.39		96		72		24		0.01		29.7		5.3		13
6	7.29	7.37		94		74		20		0.00		30.5		4.4		12
7	7.27	7.37		96		74		22		0.00		30.5		4.9		12
8	7.31	7.40		96		72		24		0.01		29.7		5.3		12
9	7.28	7.32		100		70		30		0.02		30.5		5.8		13
10	7.36	7.37		100		72		28		0.01		31.3		5.3		13
11	7.36	7.33		98		70		28		0.01		32.1		4.4		13
12	7.32	7.31		96		68		28		0.01		29.7		5.3		12
13	7.39	7.41		98		68		30		0.01		32.1		4.4		12
14	7.45	7.40		98		68		30		0.01		31.3		4.9		13
15	7.40	7.44		98		72		26		0.01		30.5		5.3		13
16	7.26	7.29		98		74		24		0.01		31.3		4.9		12
17	7.31	7.30		96		72		24		0.02		32.1		3.9		13
18	7.32	7.30		98		70		28		0.01		30.5		5.3		12
19	7.35	7.37		96		72		24		0.01		30.5		4.9		13
20	7.25	7.29		98		74		24		0		29.7		5.8		13
21	7.33	7.40		96		70		26		0.01		31.3		4.4		13
22	7.38	7.37		96		70		26		0.01		30.5		4.9		13
23	7.39	7.31		98		76		22		0.02		30.5		5.3		13
24	7.28	7.31		98		74		24		0.01		32.1		4.4		13
25	7.29	7.23		98		68		30		0.01		32.9		3.9		13
26	7.37	7.40		96		70		26		0.02		31.3		4.4		12
27	7.36	7.39		98		72		26		0.01		32.9		3.9		13
28	7.40	7.37		96		72		26		0.01		30.5		4.9		13
29	7.35	7.32		96		74		22		0.01		30.5		4.9		13
30	7.33	7.31		98		72		26		0.01		29.7		5.8		12
31	7.35	7.38		98		76		22		0.01		29.7		5.8		13
AVG	7.33	7.34		97		72		26		0.01		30.9		4.9		13
MAX	7.45	7.44		100		76		30		0.02		32.9		5.8		13.0
MIN	7.21	7.23		94		68		20		0.00		29.7		3.9		12.0



WSSN 2310

May-17

D A T E	Total Coliform						Standard Plate Count		Conductivity (mS)	Temp deg.C	Color		Odor	
	Plant Tap						Raw	Tap			Raw	Tap	Raw	Tap
			Dort	3MG Well	Sta II	Lab Tap								
	60	61	62	63	64	65	66	67	68	69		71	72	73
1					2/0	2/0			0.21	7.6				
2					2/0	2/0		<2	0.21	7.9				
3					2/0	2/0			0.21	7.2				
4					2/0	2/0			0.21	7.5				
5					1/0	1/0			0.21	7.5				
6					2/0	2/0			0.20	7.9				
7					2/0	2/0			0.20	7.6				
8					2/0	2/0			0.21	8.1				
9					2/0	2/0		<2	0.21	7.9				
10					2/0	2/0			0.21	7.8				
11					2/0	2/0			0.21	8.0				
12					2/0	2/0			0.21	8.1				
13					2/0	2/0			0.21	8.2				
14					2/0	2/0			0.22	8.4				
15					2/0	2/0			0.22	8.3				
16					2/0	2/0		2	0.21	8.8				
17					2/0	2/0			0.21	9.6				
18					2/0	2/0			0.21	9.4				
19					2/0	2/0			0.21	9.6				
20					2/0	2/0			0.20	9.4				
21					2/0	2/0			0.21	9.3				
22					2/0	2/0			0.21	9.4				
23					2/0	2/0			0.21	9.6				
24					2/0	2/0			0.21	10.1				
25					2/0	2/0			0.21	10.2				
26					2/0	2/0		2	0.21	10.0				
27					2/0	2/0			0.21	10.2				
28					2/0	2/0			0.21	10.9				
29					2/0	2/0			0.22	11.0				
30					2/0	2/0			0.21	10.7				
31					2/0	2/0		<2	0.21	10.6				
AVG									0.21	8.9				
MAX									0.22	11.0				
MIN									0.20	7.2				



Distribution System Monitoring WSSN 2310

May-17

DATE	Free Chlorine Residual at Bacteriological Monitoring Stations mg/l																									Number of Samples					
	1	2	3	4	CS	6	7	8	9	10	WR**	12	13	14	15	16	17	18	19	20	21	22	23	24	25						
1	1.35	1.26	1.52	1.45	1.44	1.31															1.18					7					
2							1.45	1.72	1.12	1.66		1.21										1.32				6					
3													1.18	1.58	1.06	1.51	1.50	1.00					1.80			7					
4					1.20	1.24						1.57								0.97	1.43			1.33		6					
5													1.09	1.02	0.99	1.57	1.42	1.11							1.37	7					
6																										0					
7																										0					
8	1.34	1.23	1.49	1.54	1.68	1.01															1.20					7					
9							1.52	1.67	1.64	1.70		1.24										1.11				6					
10													0.96	1.16	1.31	1.53	1.60	1.14					1.81			7					
11							1.41	1.68	1.62	1.69										0.99	1.32			1.44		7					
12	1.36	1.48	1.40	1.35																	1.39				1.33	6					
13																										0					
14																										0					
15	1.36	1.24	1.47	1.43	1.76	1.15															1.14					7					
16							1.32	1.57	1.44	1.37		1.57										1.28				6					
17													0.99	1.03	1.20	1.65	1.58	1.16					1.69			7					
18					1.39	1.30						1.55								1.12	1.29			1.48		6					
19													1.04	1.53	0.93	1.56	1.58	0.99							1.37	7					
20																										0					
21																										0					
22	1.29	0.88	1.43	1.36	1.31	1.15																				6					
23							1.32	1.59	1.66	1.59		1.33										1.20				6					
24													1.08	0.73	1.05	1.50	1.63	1.02					1.69			7					
25							1.36	1.65	1.59	1.63											1.21	1.44			1.29	7					
26	1.27	1.19	1.52	1.47																	1.35	1.30			1.22	7					
27																										0					
28																										0					
29																										0					
30					1.64	1.40	1.26	1.55	1.71	1.47		1.13										1.22				8					
31													0.95	1.18	1.14	1.52	1.51	1.08			0.66		1.47			8					
Monthly Cl₂ Avg.					1.35		<small>**Westside reservoir will not be sampled until repairs are finished</small>																								
Total Samples					148																										



Distribution System Monitoring

WSSN 2310

May-17

DATE	Total Chlorine Residual at Bacteriological Monitoring Stations mg/l																									Number of Samples					
	1	2	3	4	CS	6	7	8	9	10	WR**	12	13	14	15	16	17	18	19	20	21	22	23	24	25						
1	1.48	1.40	1.62	1.61	1.56	1.41															1.34					7					
2							1.56	1.82	1.28	1.77		1.34										1.45				6					
3													1.28	1.74	1.21	1.67	1.65	1.17					1.94			7					
4					1.49	1.43						1.65								1.07	1.52			1.48		6					
5													1.22	1.13	1.18	1.73	1.64	1.25							1.47	7					
6																										0					
7																										0					
8	1.46	1.33	1.66	1.64	1.80	1.24															1.34					7					
9							1.68	1.79	1.86	1.80		1.43										1.25				6					
10													1.18	1.29	1.44	1.69	1.73	1.31					1.89			7					
11							1.56	1.77	1.83	1.81										1.14	1.47			1.55		7					
12	1.50	1.61	1.60	1.58																	1.47				1.48	6					
13																										0					
14																										0					
15	1.48	1.38	1.58	1.54	1.86	1.28															1.28					7					
16							1.45	1.78	1.70	1.56		1.71										1.45				6					
17													1.15	1.14	1.44	1.75	1.72	1.27					1.90			7					
18					1.51	1.47						1.66								1.23	1.42			1.58		6					
19													1.17	1.72	1.08	1.71	1.71	1.09							1.49	7					
20																										0					
21																										0					
22	1.45	1.04	1.54	1.56	1.48	1.30																				6					
23							1.61	1.80	1.80	1.75		1.51										1.30				6					
24													1.23	0.88	1.25	1.62	1.74	1.17					1.81			7					
25							1.60	1.76	1.76	1.73														1.47		7					
26	1.41	1.37	1.67	1.61																1.30	1.63				1.34	7					
27																				1.54	1.53					0					
28																										0					
29																										0					
30					1.85	1.46	1.41	1.67	1.82	1.61		1.51										1.37				8					
31													1.30	1.45	1.37	1.69	1.64	1.24			0.77		1.84			8					
Monthly Cl₂ Avg.					1.50		****Westside reservoir will not be sampled until repairs are finished																								
Total Samples					148																										



ROUTINE POSITIVE DISTRIBUTION SAMPLES

May-17

Total number of positive routine samples:				Total Coliform: <u>0</u>			E.coli Bacteria: <u>0</u>		Chlorine Residual (mg/L)	
Date	Monitoring Station	Total Coliform	E.coli Bacteria	Date	Time	Retest of Station, Upstream & Downstream	Total Coliform	E.coli Bacteria	Free	Total
Total number of routine distribution samples analyzed:				126						
Total number of routine distribution samples required:				100						